



Backflow Prevention Questionnaire
(Required for all water services, new or renewal)

As part of our on-going efforts to ensure the safety of your drinking water, we are required to protect our system against cross-connections. As described in the enclosed brochure, cross-connections are connections between the drinking water plumbing and a source of contamination. Cross-connections can make our drinking water unsafe.

The purpose of this questionnaire is to help determine if you have any special plumbing or activities that pose an increased risk of contamination to our water system. Please fill out the following questionnaire below:

OWNER: _____ METERED: Yes ___ No: ___

ADDRESS: _____ METER SIZE: _____

TYPE OF SERVICE: ___ Residential, ___ Commercial, ___ Industrial,
___ Residential/Commercial, ___ Agricultural, other ___ (list)

NEW CONSTRUCTION: _____

EXISTING HOME/BUSINESS _____

TYPE OF PREMISE: ___ Single Family, ___ Multiple Dwelling: # of Units ___

WATER USED FOR: ___ Processing, ___ Product, ___ Cooling, ___ Sanitary,
___ Culinary/Drinking, ___ Other(list) _____

TYPE OF HEATING: ___ Forced Air, ___ Electric, ___ Solar, ___ Heat Pump,
___ Boiler, ___ Steam, ___ Hot Water, ___ Geothermal
___ Other(list) _____

TYPE OF COOLING: ___ Air Conditioning, ___ Cooling Tower, if so is there a air-gap at supply ___ Yes ___ No

WELL: ___ Yes ___ No

CISTERN: ___ Yes ___ No

LAWN SPRINKLER SYSTEM: ___ Yes ___ No

CHEMICAL TREATMENT: Yes No

SELF DRAINING YARD HYDRANTS, FOUNTAINS, HOSE BOXES:
 Yes No

SWIMMING POOL: Yes No
If yes, filled by hose or piped connection

DISHWASHER: Commercial Residential None

WHIRLPOOL/HOTTUB: Yes No
If yes, filled by Hose Piped Connection

PLEASE LIST ANY OTHER WATER USE PRACTICES NOT LISTED ABOVE:

TO BE SIGNED BY PERSON MAKING APPLICATION FOR WATER SERVICE


I hereby certify that all information is complete and correct. I further acknowledge that incomplete or incorrect information may result in an additional or different requirement insofar as Backflow Prevention Assemblies at the water service connection are concerned.

Name (print) _____

Signature _____ Date _____

Telephone Number _____



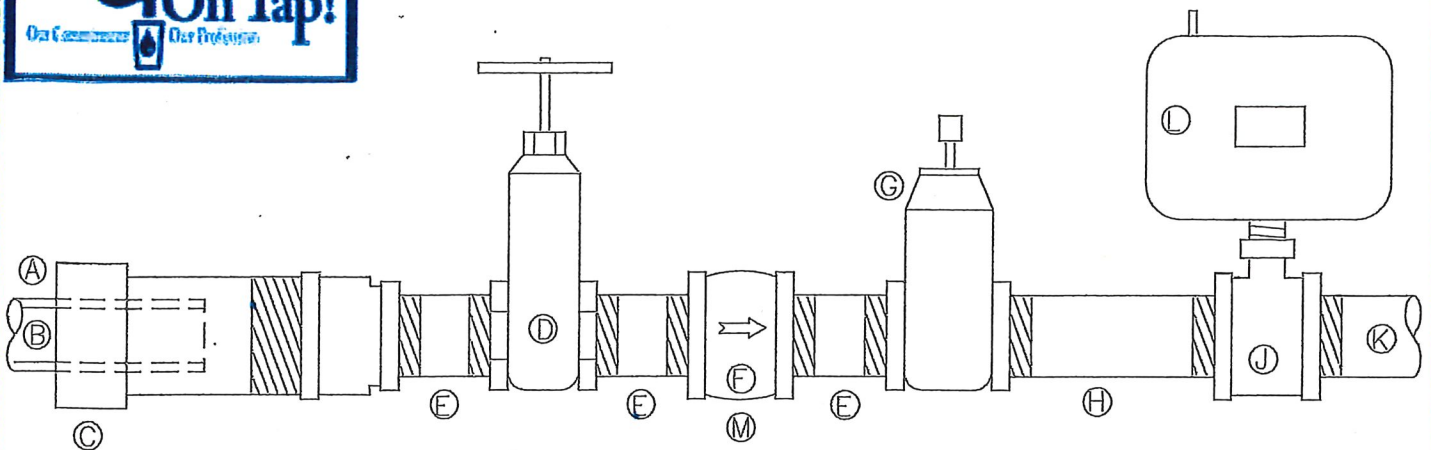

- (A) MINIMUM 1" CTS 200 PSI POLY SERVICE LINE
- (B) 1" INSERT STIFFENER
- (C) 1" CTS X 3/4" MIP COMPRESSION FITTING
- (D) 3/4" I.P. BRONZE GATE VALVE OR BALL VALVE
- (E) 3/4" X 2" BRASS PIPE NIPPLE
- (F) 3/4" I.P. BRONZE DUAL CHECK VALVE
- (G) 3/4" BRASS PRESSURE REDUCING VALVE
- (H) 3/4" X 4" BRASS PIPE NIPPLE
- (J) 3/4" BRASS TEE FITTING
- (K) 3/4" WROT COPPER X M.I.P. FITTING
- (L) PRESSURE/SHOCK ABSORBING AIR CELL
- (M) 3/4" BACKFLOW PREVENTER REQUIRED FOR COMMERCIAL, INDUSTRIAL, AND AGRICULTURAL SERVICES AND ALL SERVICES WITH A AUXILIARY WATER SUPPLY.

* IF CUSTOMER HAS THE SERVICE LINE RAN, THE 3/4" F.I.P. X SIZE OF PIPE FITTING TAPED TO PIPE SERVICE WILL BE CONNECTED AT TIME SERVICE IS INSTALLED.

NORTHERN OHIO RURAL WATER

RECOMMENDED RURAL WATER
CONNECTION 3/4" SERVICE

SCALE: NTS

